

Mount Holly Municipal Utilities Authority  
 New Jersey Certification Number: 03348  
 37 Washington Street PO Box 486  
 Mount Holly, NJ 08060

Certificate of Analysis

Report Date: 7/24/01

Client: Robert Hult  
 Mount Holly MU Authority  
 37 Washington Street  
 Mount Holly, NJ

Sample Collected By: MHMUA  
 Date Collected: 6/12/01  
 Time Collected: 10:00  
 Date Received: 6/12/01  
 MHMUA Laboratory Number: 11842


Sample Description: Inceptor Influent/Effluent

Project Name: Stormdrain Monitoring  
 Project Number: Streams

Parameter	Influent	Effluent	Unit
Carbonaceous Biochemical Oxygen Demand	125	34.7	mg/L
Chemical Oxygen Demand	666	114	mg/L
Chromium	49.3	23.3	mg/L
Copper	101	36	mg/L
Lead	170	24.7	mg/L
Mercury	<1	1.29	mg/L
Solids – Total Dissolved	154	88	mg/L
Solids – Total Suspended	2,244	169	mg/L
Zinc	815	713	mg/L
PH (Aqueous)	6.29	6.25	
Oil/Grease	21.3	ND	mg/L

\*ND – Not Detected

<u>Pollutants</u>	<u>Influent</u>	<u>Effluent</u>
Acetone	22.2 ug/L	9.95 mg/L
Ammonia Nitrogen	1.5 ug/L	0.2 mg/L
Chemical Oxygen Demand	666 ug/L	114 mg/L
Chromium	49.3 ug/L	23.3 mg/L
Copper	101.0 ug/L	36.0 mg/L
Lead	27.3 ug/L	1.94 mg/L
Oil & Grease	21.3 mg/L	ND mg/L
Solids–Total Dissolved	154.0 ug/L	88.0 mg/L
Solids-Total Suspended	2244 mg/L	169 mg/L

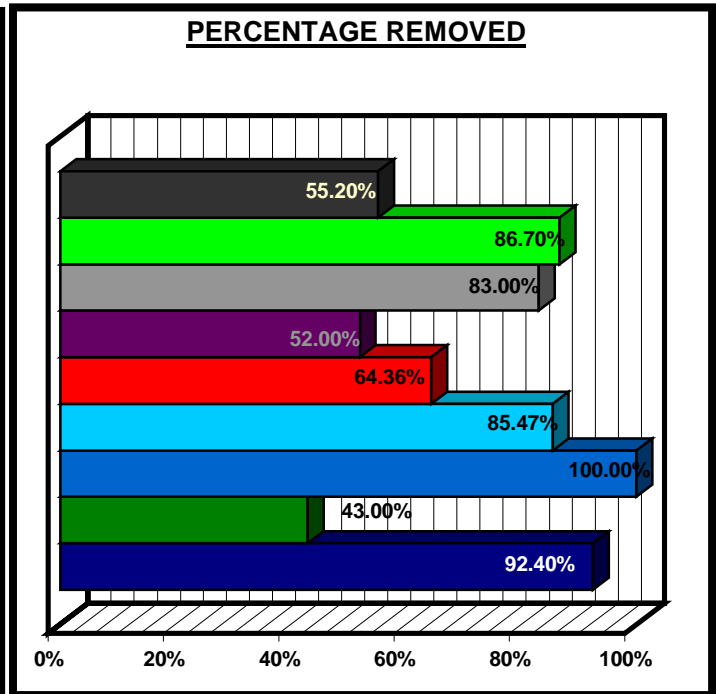

QC Laboratories  
 1205 Industrial Blvd., P.O.Box 514, Southampton, PA 18966-0514  
 Phone: 215-355-3900  
 Fax: 215-355-7231